


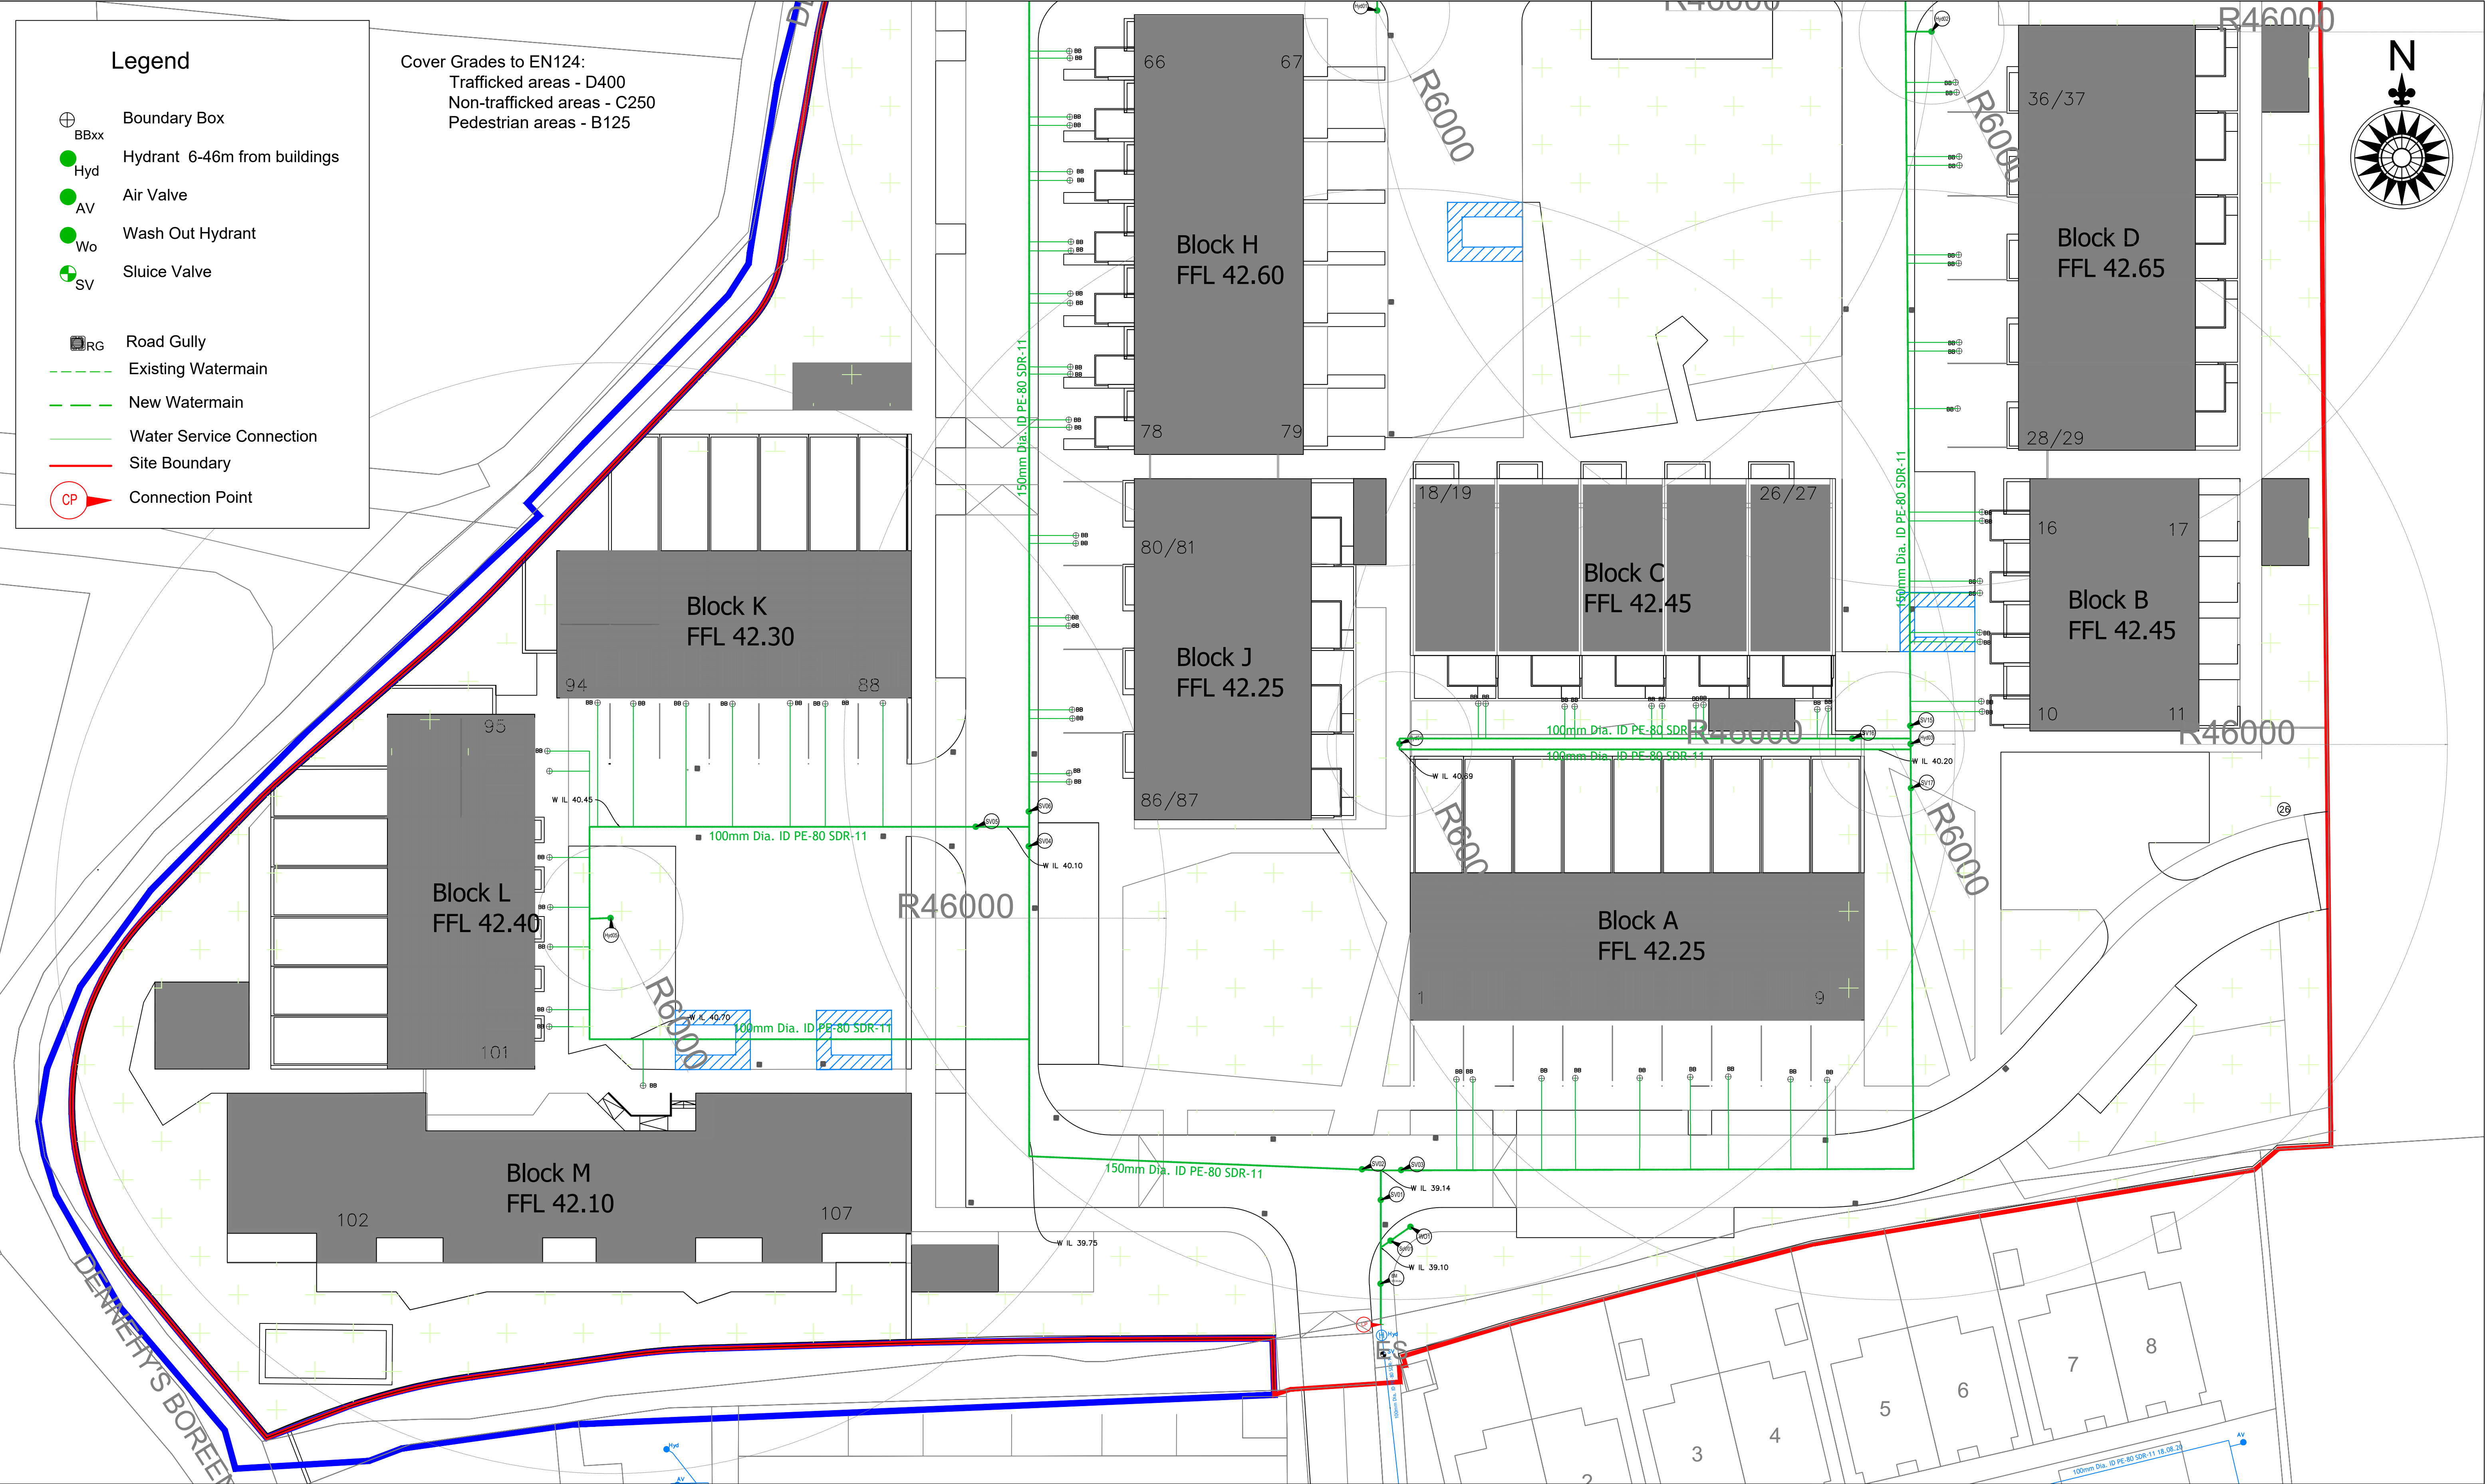

Pipe Specifications:
Water Pipes:

MDPE pipes shall be of a type PE-80 and have an SDR-11 rating. They shall conform to IS EN 12201: Part 1 and Part 2 (Plastic Systems for Water Supply, Drainage and Sewerage Under Pressure – Part 1, General, and Part 2, Pipes) and I.S. EN 12201-3 (Plastic Systems for Water Supply, Drainage and Sewerage Under Pressure – Part 3 Fittings). Joints shall be push in rubber ring joint. Thrust blocks shall be used in accordance to STD-W-28

Depth of Cover:

The desirable minimum depth of cover from the finished ground level to the external crown of a single premise Service Connection pipe shall be 750mm with an absolute minimum of 600mm for short distances (subject to Irish Water agreement). The desirable depth of cover at the Boundary Box should be 600mm +/- 25mm, with a maximum depth of 750mm.

The minimum depth of cover from the finished ground level to the external crown of a Water Main shall be 900mm where the pipe is to be located in housing estate roads. A greater depth of cover and/or greater strength pipe and/or a higher class of bedding may be required where higher traffic loading is anticipated. Depths may be altered to avoid obstructions, including separation distances between other utility services. The desirable cover for a water main should be 1,200mm, where practicable and should not exceed 3.0m. The desirable maximum cover for service connection pipe should be 1,200mm, where practicable.

Refer to revision sheet for all amendment details

Rev	Date	General Revision	Drwn	chkd
B	21.07.26	Layout	JON	MC
A	17.12.25	Layout	JON	MC

Rev	Date	General Revision	Drwn	chkd
Issue for:	Planning			

Client:
Wrightwood Developments Ltd.

Project Title:
New Development at, Ardshanavooley, Killarney

Drwg Title:
Water Layout (1)

Drwn by:	Date
JON	Sept 2025

chkd by:	Date
M.C	Sept 2025

Job No:	Scale	paper size
91-24	1:250	A1

Drwg No:	Ref	Sheet	Rev
91-24-1-805		B	

teicniuil-priory
consulting engineers

6 PRIGORY GROVE,
FAIR HILL,
KILLARNEY
CO. KERRY
TEL: 064 6631947
EMAIL: matt@tpce.ie

Site Boundaries Outlined in Red.